


NOTES

1. All dimensions are in millimetres unless shown otherwise.
2. Ductile iron covers to catchpits to be positioned on side furthest from the carriageway where possible.
3. For detail of individual oil interceptors and invert levels of pipes, see drainage schedules.
4. Bricks to be Class B clay engineering bricks to B.S. 3921 laid in accordance with the 2400 series in English Bond.
5. Finish to internal concrete to be F2 on formed surfaces and U2 on unformed surfaces to clause 1708.
6. The length of articulated pipe shall be as required by table 5/6 of clause 507 at inlet and outlet.
7. Standard concrete mixes shall comply with clause 2602.
8. Cement mortar shall be mixed in the proportions given in Table 24/1. For mortar designation see Appendix 24/1.
9. For structural concrete mixes see Appendix 17/1.

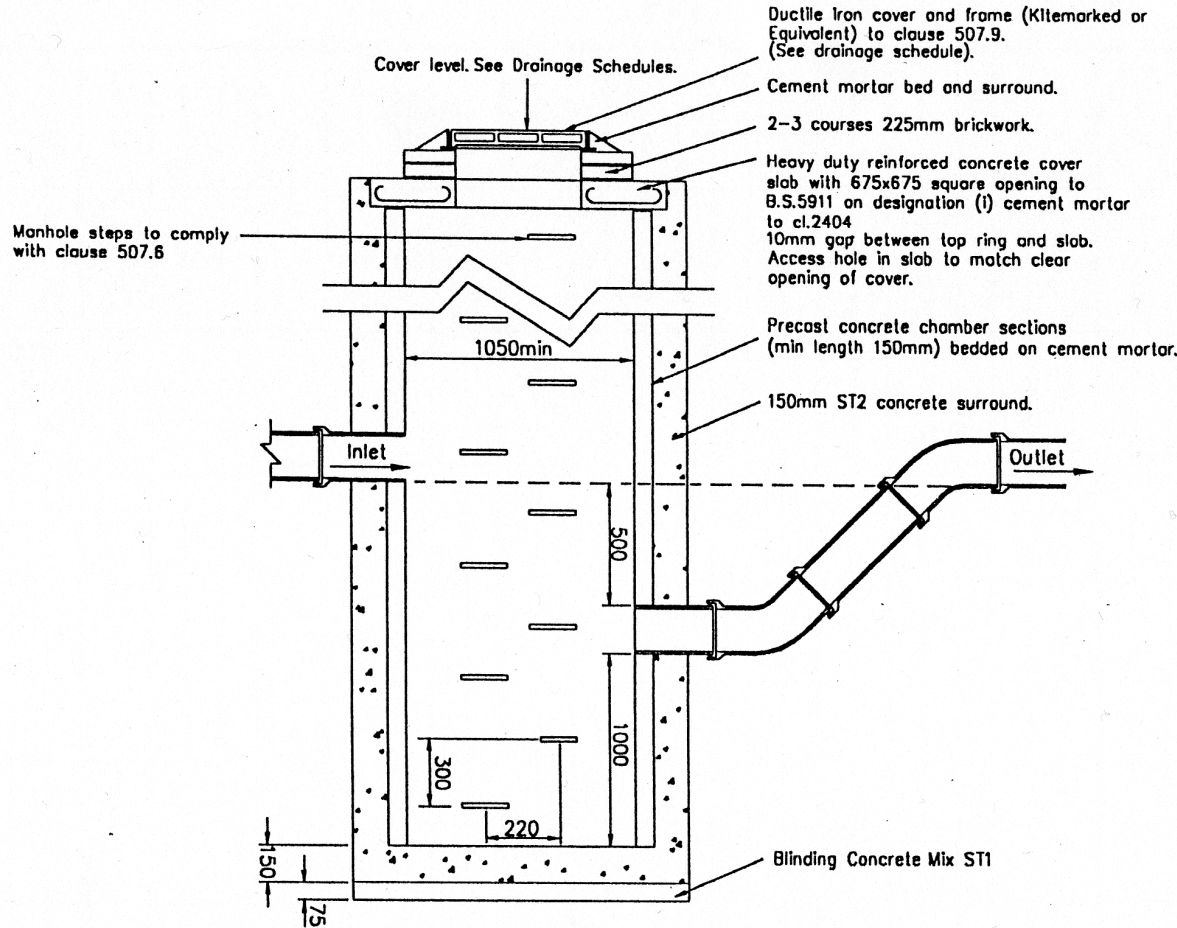

David Young
 Director of Environmental Services
 Oxfordshire County Council
 Speedwell House, Speedwell Street,
 Oxford OX1 1NE
 Tel. Oxford 792422

OIL INTERCEPTOR

DRAINAGE

© Unauthorised reproduction infringes copyright

SCALE

Not to Scale

INITIALS

DATE

DRAWN

TRACED

CHECKED

[Signature]

2.1.00

INDEX

AMENDMENT

DATE

DRAWING No.

CATEGORY

HSD/5/425