


100 x 100 block (cut block). Small cuts (less than $\frac{1}{4}$ of a block) are not permitted

double course of stretcher bond adjacent to all iron works within the carriageway

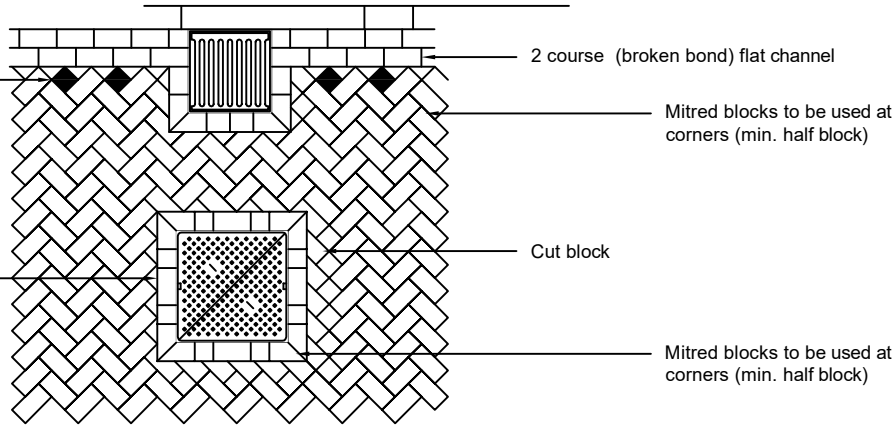


In block paved areas all ironwork shall be 150 deep to allow blocks to be laid up to the frame of gully gratings and manhole covers. Cover levels are to be recessed 5mm below finished surface level.

Notes:

1. All dimensions are in millimetres unless shown otherwise.
2. Construction thicknesses below the block paving and bedding layer shall comply with those given on HSD/700/005 (Minor Access Roads), HSD/700/010 (Major Access Roads) and HSD/1100/010 (Footways).
3. This detail should be used where gradient is greater than 1:20.
4. Coring to be considered only where there is a bottom of a steep gradient.
5. For further information refer to Standard Details Guidance Note drawing no. HSD/100/001

GULLY AND MANHOLE DETAIL

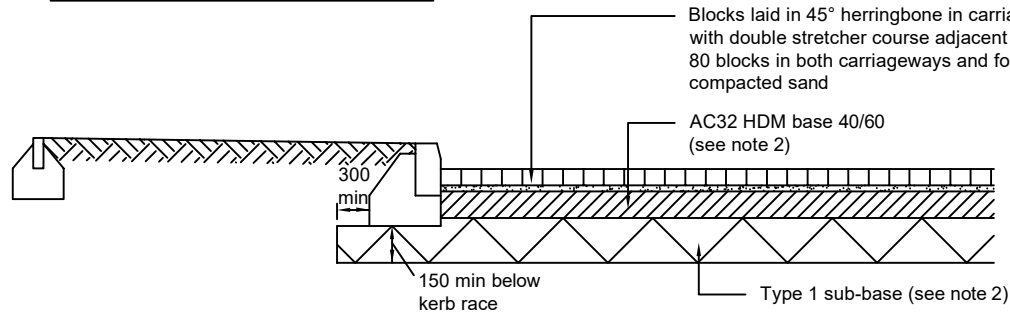

TYPICAL CROSS SECTION

DRAWING TITLE:
Series 1100: Kerbs, Footways and Paved Areas - Impermeable Block Paved Roads and Footways

SCALE: NTS

DRAWN CHECKED

INITIALS: CS MS

DATE: 12/01/2024 12/01/2024

REV	AMENDMENTS	DRN	CHK'D	DATE

DRAWING NO:

HSD/1100/040

