


FRONT ELEVATION

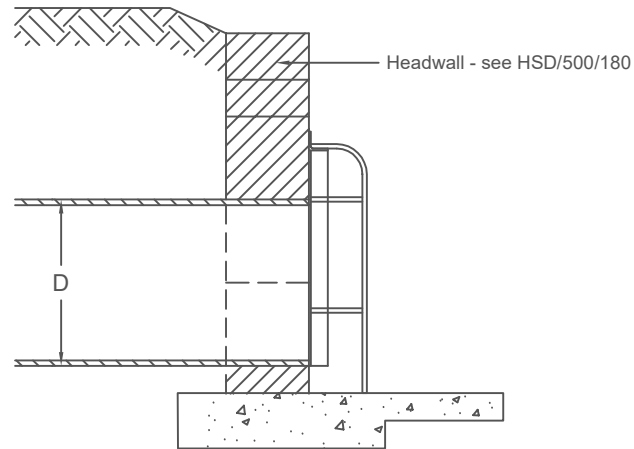

SECTION A-A

Notes:

1. All dimensions are in millimetres unless shown otherwise.
2. All steel used in the construction of the grid and frame to be grade S275 to BS EN 10025:2 and hot dip galvanised in accordance with BS EN ISO 1461.
3. The grids shall be fabricated and erected to the requirements of BS 5950-2.
4. Anchor bolts shall be stainless steel through bolts complying with BS EN ISO 3506-1 with an anchor length of at least 100mm and suitable for use with the materials from which the headwall is constructed.
5. For further information refer to Standard Details Guidance Note drawing no. HSD/100/001

DRAWING TITLE:
Headwalls - Grid for Outfalls of 375mm Diameter and Above

SCALE: NTS

DRAWN CHECKED

INITIALS: CS MS

DATE: 12/01/2024 12/01/2024

REV	AMENDMENTS	DRN	CHCK'D	DATE

DRAWING NO:

HSD/500/195

